


# "SAFETY EDGE" & POLYCARB STORM PANELS


28ga (0.018") STEEL & 0.100" POLYCARB

FRANK L. BENNARDO, P.E.  
# PE0046549


12/31/2008

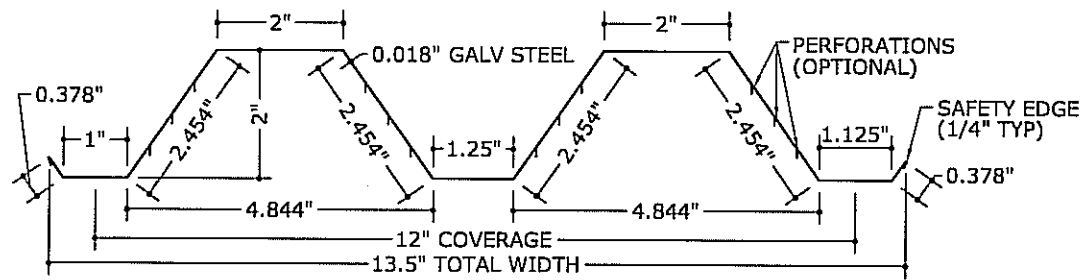


**1a** STEEL STORM PANEL PROFILE  
4" = 1'-0" SECTION

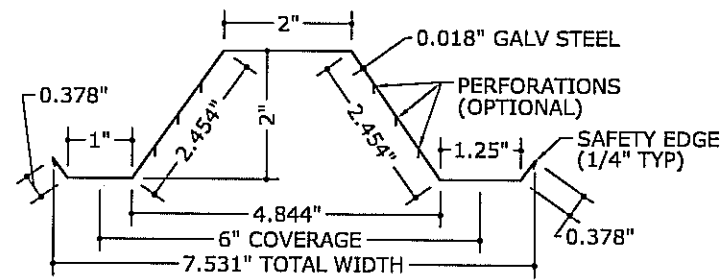


**1b** STEEL HALF-PANEL PROFILE  
4" = 1'-0" SECTION

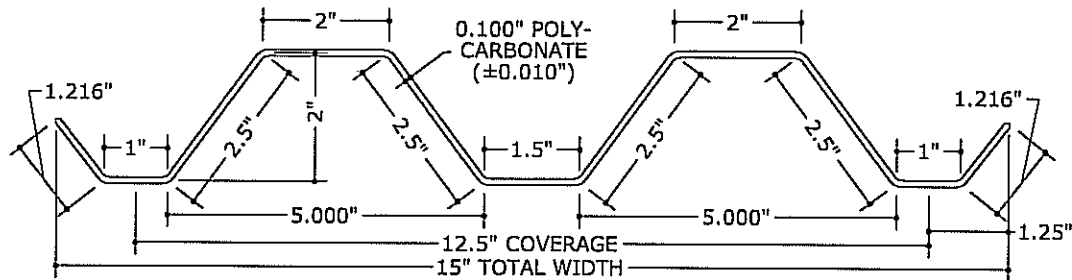

**1c** POLYCARB STORM PANEL PROFILE  
4" = 1'-0" SECTION

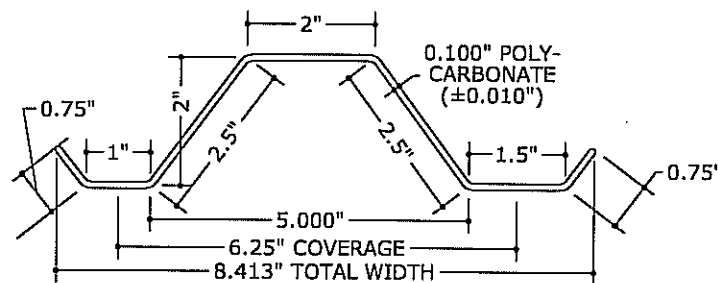


**1d** POLYCARB HALF-PANEL PROFILE  
4" = 1'-0" SECTION

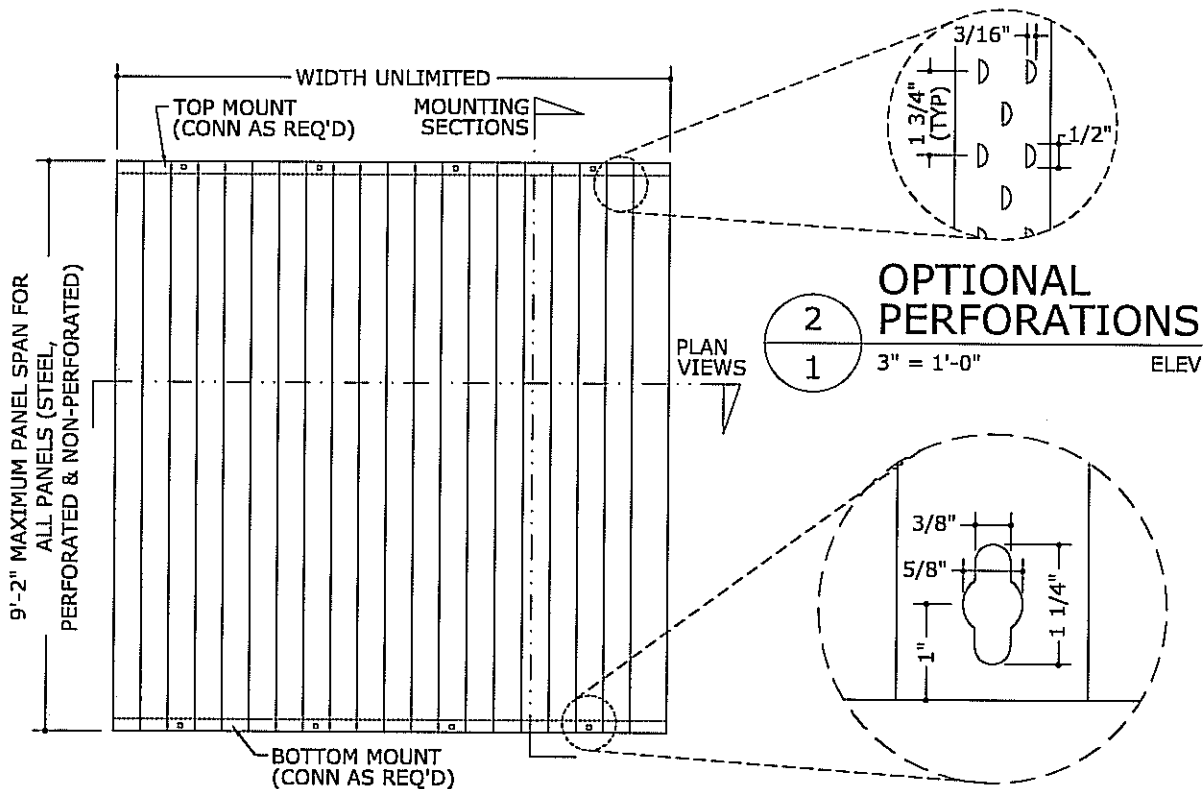


**1** TYPICAL ELEVATION  
1 N.T.S.


**3** KEYHOLE PUNCH  
1 6" = 1'-0" ELEV

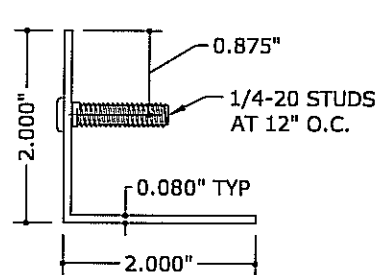


**2** STUDDED ANGLE  
6" = 1'-0"

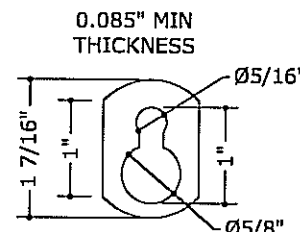

**3** KEYHOLE WASHER  
6" = 1'-0"

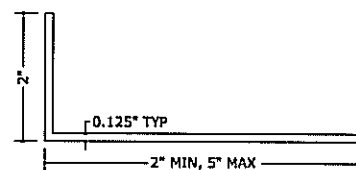

**4** ALUMINUM CLOSURE  
4" = 1'-0"

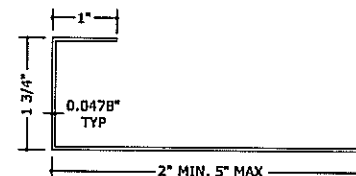

**5** STEEL J-PAN CLOSURE  
4" = 1'-0"

## GENERAL NOTES:

- THIS SYSTEM HAS BEEN TESTED AND EVALUATED AS A LARGE MISSILE IMPACT PROTECTIVE SYSTEM IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, CURRENT EDITION, FOR USE OUTSIDE THE HIGH VELOCITY HURRICANE ZONE PER ASTM STANDARDS E330, E1886, & E1996.
- NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS PRODUCT. WID LOAD DURATION FACTOR Cd=1.6 HAS BEEN USED FOR WOOD ANCHOR DESIGN.
- POSITIVE AND NEGATIVE DESIGN PRESSURES TO BE USED WITH THESE DRAWINGS SHALL BE DETERMINED BY OTHERS FOR SPECIFIC JOBS IN ACCORDANCE WITH THE GOVERNING CODE. WHEN CALCULATING PRESSURES PER ASCE 7, USE OF DIRECTIONALITY FACTOR Kd=0.85 IS ALLOWED.
- THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. IF SITE CONDITIONS DEVIATE FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO BE USED IN CONJUNCTION WITH THIS DOCUMENT.
- PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND NEW SUPERIMPOSED LOADS.
- CLEAR POLYCARBONATE PANELS SHALL BE ALTERNATED WITH 0.018" (MIN) GALV STEEL PANELS SUCH THAT NO TWO POLYCARBONATE PANELS ARE ADJACENT TO EACH OTHER.
- ALL PANELS SHALL BE INSTALLED USING KEYHOLE WASHERS IN CONJUNCTION WITH ALL MOUNTING CONDITIONS.
- ALL GALV STEEL STORM PANELS SHALL HAVE MIN GALVANIZED THICKNESS t=0.018" CONFORMING TO ASTM A653, STRUCTURAL QUALITY GRADE 40, WITH G60 GALVANIZED COATING AND MIN Fy=44.58 KSI.
- CLEAR POLYCARBONATE STORM PANELS WITH 12.5" COVERAGE SHALL BE MFD BY TRANSPARENT PROTECTION SYSTEMS, Inc., AND THOSE WITH 6.25" COVERAGE SHALL BE MANUFACTURED BY TOWN & COUNTRY INDUSTRIES, Inc. ALL POLYCARB PANELS SHALL BE EXTRUDED WITH MIN THICKNESS t=0.100" (±0.010") AND SHALL BE FABRICATED FROM 100% G.E. SYNTHETIC THERMOPLASTIC POLYMER LEXAN RESIN #103-112 (UV STABILIZED) OR EQUIVALENT. THIS MATERIAL IS COMPARABLE TO G.E. LEXAN POLYMER SHEET #9034, AS APPROVED UNDER MIAMI-DADE COUNTY NOTICE OF ACCEPTANCE #03-0924.01. MINIMUM SYNTHETIC THERMOPLASTIC POLYMER TENSILE STRENGTH Fy=8.908 KSI, FLEXURAL STRENGTH Fby=12.90 KSI, & FLEXURAL MODULUS IS 328.7 KSI.
- ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY, UNLESS NOTED OTHERWISE.
- PANELS SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE LABEL PER PANEL AS FOLLOWS:  
TOWN & COUNTRY IND.  
ASTM E1886, E1996 & E330  
MISSILE D FBC APPROVED
- STORM PANELS HAVE BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS AND LOADS SHOWN ON THESE DRAWINGS. REFERENCE CONSTRUCTION TESTING CORPORATION (CTC OF MIAMI, FL) TEST REPORTS #04-004, #04-005, & #04-006.
- TOP & BOTTOM DETAILS SHOWN MAY BE INTERCHANGED AS FIELD CONDITIONS DICTATE. PANELS MAY BE MOUNTED HORIZONTALLY WHERE APPLICABLE.
- ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, STAINLESS STEEL, OR 2024-T4 ALUMINUM ALLOY WITH A MINIMUM TENSILE YIELD STRENGTH OF 33 KSI.

LICENSED AFFILIATE OF  
**ENGINEERING EXPRESS**  
160 SW 12th AVENUE, #106  
DEERFIELD BEACH, FL 33442  
PH: (954) 354-0660 FAX: (954) 354-0663  
WWW.ENGINEXP.COM

**Town & Country INDUSTRIES**  
400 WEST MCNAB ROAD  
FORT LAUDERDALE, FL 33309  
"SAFETY EDGE" & POLYCARBONATE STORM PANELS  
28ga STEEL & 0.100" POLYCARB  
FLORIDA STATEWIDE APPROVAL

DRWN/CHKD	DATE
CL	9/22/05
FLB	12/30/08
RKB	
CL	

REMARKS  
INIT ISSUE  
2007 FBC


THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E.  
\* ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT FRANK L. BENNARDO P.E.


05-TCM-0001

PAGE SCALE:  
DESCRIPTION:


F:\01 Project Files\Town And Country (TCM)\2005 Jobs\05-TCM-0001 28ga. 0.022" Polycarb Panels; Formerly Madden (FSA)\05-TCM-0001\_02a 28ga & Polycarb Storm Panels (FSA).dwg  
 12/31/2008 - 12:24pm rbarlett

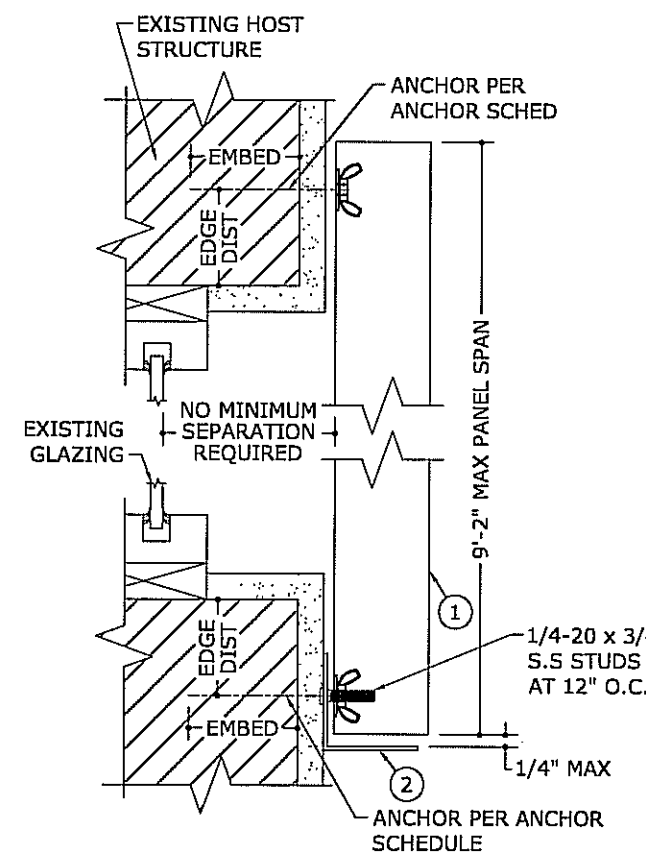


**1 MOUNTING SECTION**  
 2 3" = 1'-0"

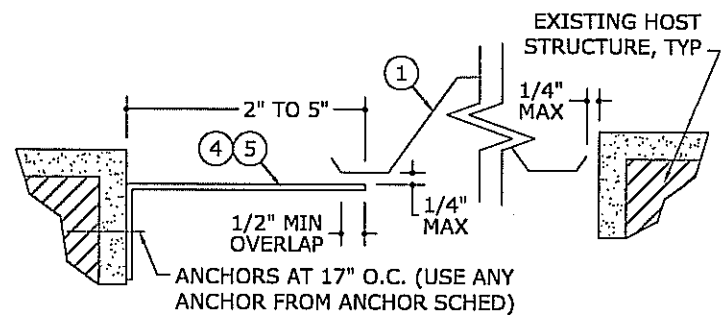

**2 TRAP MOUNT CLOSURE**  
 2 3" = 1'-0" PLAN VIEW

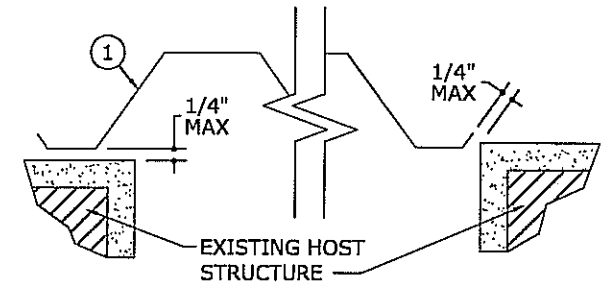


**3 WALL MOUNT CLOSURE**  
 2 3" = 1'-0" PLAN VIEW

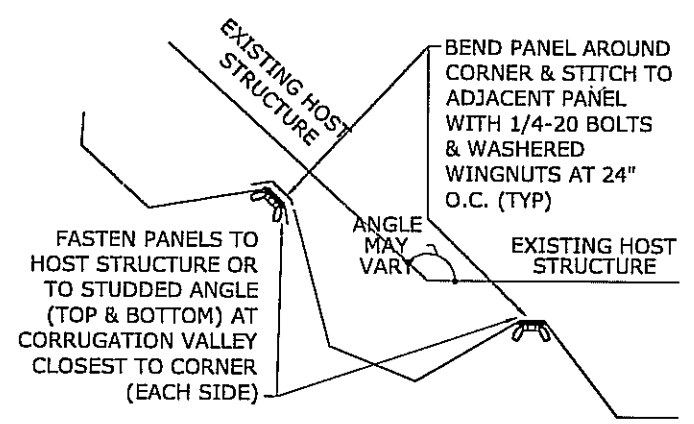

**4 CORNER CLOSURE**  
 2 N.T.S. PLAN VIEW

SPAN SCHEDULE	
<b>28ga (0.018") GALV STEEL PANELS</b>	
MAX LOAD:	±54.0 psf
MAX SPAN:	9'-2" (ALL MOUNTING CONDITIONS)
MIN SPANS:	26" (DIRECT MOUNT TOP & BOTTOM)
	16" (ALL OTHER CONDITIONS)
<b>0.100" CLEAR POLYCARB FULL-/HALF-PANELS</b>	
MAX LOAD:	±54.0 psf
MAX SPAN:	9'-2" (ALL MOUNTING CONDITIONS)
MIN SPANS:	24" (DIRECT MOUNT TOP & BOTTOM)
	15" (ALL OTHER CONDITIONS)

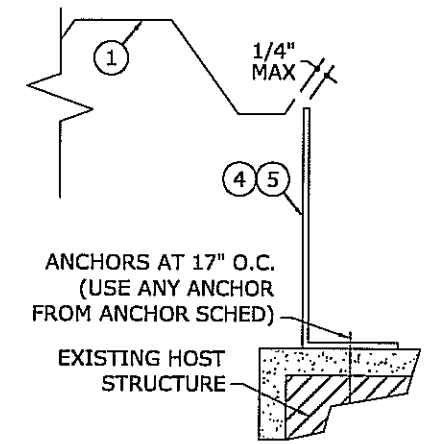

**5 BUILD-OUT MOUNT CLOSURE**  
 2 3" = 1'-0" PLAN VIEW

FRANK L. BENNARDO, P.E.  
 # PE0046549  
 12/31/2008  
 LICENSED AFFILIATE OF  
**ENGINEERING EXPRESS**  
 160 SW 12th AVENUE, #106  
 DEERFIELD BEACH, FL 33442  
 Ph: (954) 354-0660 Fax: (954) 354-0443  
 WWW.ENGEXP.COM  
 CERT OF AUTH #8885

**Town & Country INDUSTRIES**  
 400 WEST MCNAB ROAD  
 FORT LAUDERDALE, FL 33309  
 "SAFETY EDGE" & POLYCARBONATE STORM PANELS  
 28ga STEEL & 0.100" POLYCARB  
 FLORIDA STATEWIDE APPROVAL

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	9/22/05
2007 FBC	RKB	CL	12/30/08




THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT THE WRITTEN PERMISSION OF FRANK L. BENNARDO, P.E. ANY ALTERATIONS, ADDITIONS, DELETIONS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.




COPYRIGHT FRANK L. BENNARDO P.E.  
**05-TCM-0001**  
 PAGE SCALE:  
 DESCRIPTION:  
 2




## ANCHOR NOTES:





- 1) 1/4" TAPCONS MAY BE BY ITW OR BY ELCO. "ELCO PANELMATE" ANCHORS MAY BE ELCO FEMALE PANELMATE OR ELCO PANELMATE PLUS, AS ILLUSTRATED.
- 2) ENSURE MINIMUM 2" EDGE DISTANCE FOR ANCHORS TO CONCRETE & TO HOLLOW BLOCK. EDGE DISTANCE OF 3/4" IS ACCEPTABLE FOR ANCHORS TO WOOD, WITH THE EXCEPTION OF PANELMATE ANCHORS FOR WHICH 2" MIN EDGE DISTANCE IS REQUIRED. FOR PANELMATES TO WOOD WITH 3/4" MIN EDGE DISTANCE, ALLOWABLE SPACING SHALL BE 6" O.C.
- 3) MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
- 4) ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- 5) WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT PLYWOOD.
- 6) WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x4 (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING). WOOD STUD SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY, UNLESS OTHERWISE NOTED.
- 7) ANCHOR SCHEDULE APPLIES FOR ALL PRODUCTS CERTIFIED HEREIN, BUT ONLY PROVIDES MAXIMUM ALLOWABLE ANCHOR SPACING. MAXIMUM ALLOWABLE SPANS AND PRESSURES INDICATED IN SPAN SCHEDULE SHALL APPLY.
- 8) MACHINE SCREWS SHALL HAVE MINIMUM OF 1/2" ENGAGEMENT OF THREADS IN BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD ("SIDEWALK BOLT") U.N.O.

## ANCHOR SCHEDULE

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 9'-2"
CONCRETE	1/4" TAPCON (ELCO OR ITW) x 1-3/4" EMBED (3192psi MIN CONC) 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	16.0"
		54	16.0"	16.0"
	1/4" PANELMATE (PLUS OR FEMALE) x 1-3/4" EMBED (3350psi MIN CONC) 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	16.0"
		54	16.0"	16.0"
	1/4" ALL POINTS SOLID-SET ANCHOR x 7/8" EMBED (3000psi MIN CONC) 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	16.0"
		54	16.0"	16.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 9'-2"
HOLLOW BLOCK	1/4" TAPCON (ELCO OR ITW) x 1-1/4" EMBED 	33	16.0"	12.4"
		38	16.0"	10.7"
		47	15.9"	8.7"
		54	13.9"	7.6"
	1/4" PANELMATE (PLUS OR FEMALE) x 1-1/4" EMBED 	33	16.0"	10.9"
		38	16.0"	9.5"
		47	14.1"	7.7"
		54	12.2"	6.7"
	1/4" ALL POINTS SOLID-SET ANCHOR x 7/8" EMBED 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	16.0"
		54	16.0"	16.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 9'-2"
WOOD (G=0.55 MIN SPECIFIC GRAVITY)	1/4" TAPCON OR #14 WOOD SCREW x 2" EMBED 	33	16.0"	15.2"
		38	16.0"	13.2"
		47	16.0"	10.7"
		54	16.0"	9.3"
	1/4" PANELMATE (PLUS OR FEMALE) x 1-7/8" EMBED (2" MIN EDGE DISTANCE) 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	16.0"
		54	16.0"	16.0"
	1/4" LAG SCREW x 2" THREAD EMBED ↑ EMBED ↓ 	33	16.0"	15.5"
		38	16.0"	13.4"
		47	16.0"	10.9"
		54	16.0"	9.5"

HOST STRUCT.	ANCHOR	LOAD (psf)	Spans Up To 5'-0"	Spans Up To 9'-2"
WOOD (G=0.42 MIN SPECIFIC GRAVITY)	1/4" TAPCON (ELCO OR ITW) x 2" EMBED 	33	16.0"	13.5"
		38	16.0"	11.7"
		47	16.0"	9.5"
		54	15.1"	8.3"
	1/4" PANELMATE (PLUS OR FEMALE) x 1-7/8" EMBED (2" MIN EDGE DISTANCE) 	33	16.0"	13.1"
		38	16.0"	11.4"
		47	16.0"	9.2"
		54	14.7"	8.0"
	1/4" LAG SCREW x 2" EMBEDMENT ↑ EMBED ↓ 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	13.5"
		54	16.0"	11.8"
	1/4" 18-8 STAINLESS STEEL HANGER BOLT x 2" EMBED ↑ EMBED ↓ 	33	16.0"	16.0"
		38	16.0"	16.0"
		47	16.0"	13.5"
		54	16.0"	11.8"

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	CL	FLB	9/22/05
2007 FBC	RKE	CL	12/30/08

THIS DOCUMENT IS THE PROPERTY OF FRANK L. BENNARDO, P.E. AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF FRANK L. BENNARDO, P.E.  
\* ALTERATIONS, ADDITIONS, HIGHLIGHTING, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.